


RTR Series Rack Mount Cabinet Installation Procedure

SEPTEMBER 2009

Rack Installation:

Rack Mount Cabinet (RTR12B) is adapted for mounting the cabinet to a 19" rack. The recessed bulkhead allows the cabinet to mount flush with the 19" rack.

Mount the cabinet to the equipment rack at the desired height with mounting screws provided.

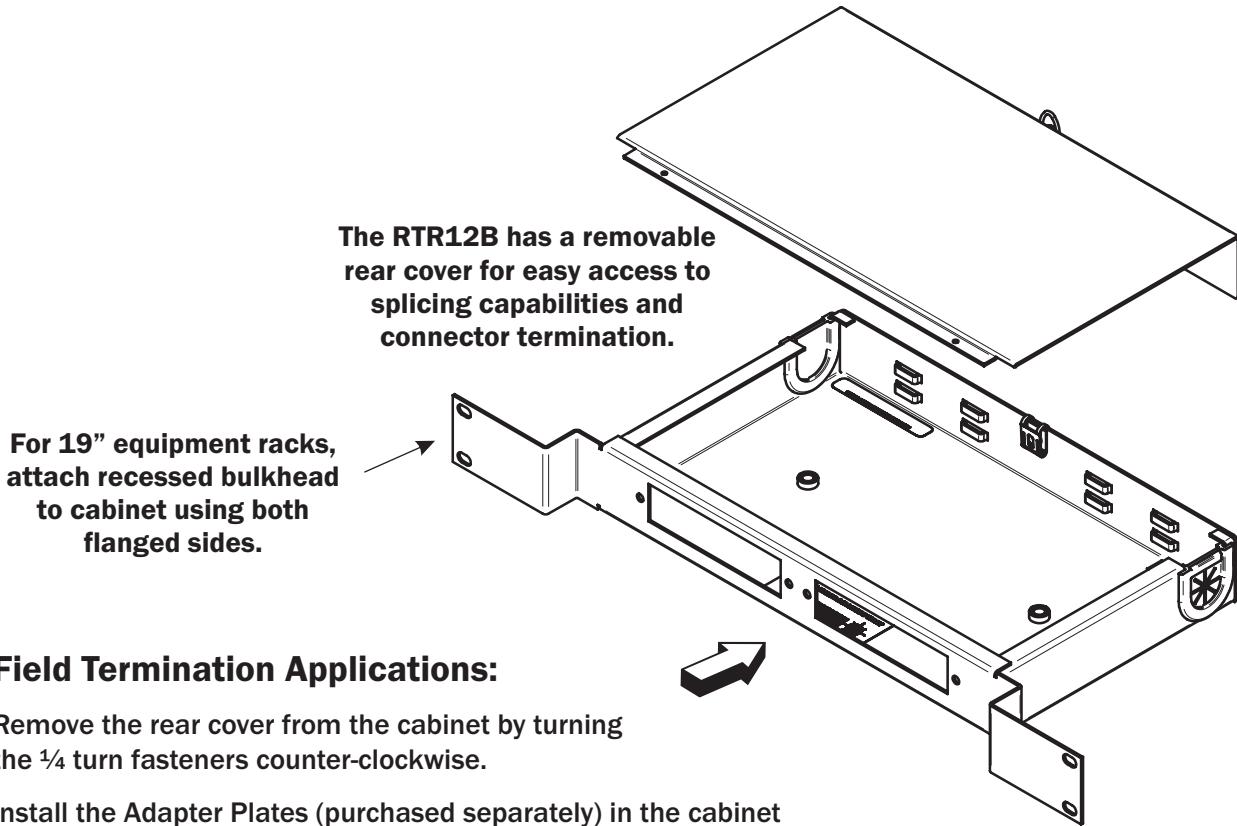

Field Termination Applications:

Remove the rear cover from the cabinet by turning the $\frac{1}{4}$ turn fasteners counter-clockwise.


Install the Adapter Plates (purchased separately) in the cabinet bulkhead using the push fasteners to secure them.

Slit the appropriate grommet for cable entry at the rear of the cabinet. Then route the individual jacketed fiber elements around the inside of the cabinet compartment 1 1/2 times for a cable entering either the left side or the right side of the cabinet.

Mark the jacketed fiber elements at a point about 1 inch beyond where they contact the bulkhead (this provides additional fiber length for application of the connectors).

Field install the connectors to the jacketed fiber elements according to your accepted company practices, and recommendations from the connector supplier.

Install the connectorized fiber elements to the port openings on the Adapter Plates.

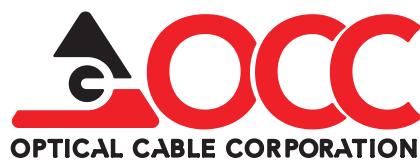

5290 Concourse Drive • Roanoke, VA 24019 USA
Phone: 540-265-0690 • TOLL FREE 800-622-7711
Fax: 540-265-0724 • www.occfiber.com